ELECTRICAL CONTRACTOR TO INCLUDE IN HIS BID LOW VOLTAGE CAT 5 CABLES, RJ45 TELEPHONE JACKS, AND THE INSTALLATION OF ALL CABLING AND DEVICES, INCLUDING DATA/COMM (SPECS NOT BY FAE). ALL DEVICES ARE TO BE RUN OVERHEAD. COORDINATE ALL LOCATIONS WITH OWNER PRIOR TO BID/CONSTRUCTION.

FIRE RATING NOTE

THE ELECTRICAL CONTRACTOR TO MAINTAIN FIRE RATINGS FOR ALL ELECTRICAL DEVICES OR CONDUIT PENETRATING FIRE RATED WALLS, FLOORS, OR CEILINGS. (EQUAL TO WALL FIRE RATING - SEE ARCHITECTURAL DRAWINGS)

LOW VOLTAGE NOTE

CONTRACTOR TO COORDINATE LOCATION AND REQUIREMENTS OF ALL LOW VOLTAGE WIRING AND TELEPHONE/DATA/TV DEVICES PRIOR TO CONSTRUCTION.

COORDINATION NOTE

CONTRACTOR TO COORDINATE ALL FINAL LOCATIONS ANY TYPES OF ALL DEVICES AND EQUIPMENT WITH ARCHITECT PRIOR TO INSTALLATION.

GENERAL NOTE

PRIOR TO SUBMITTING HIS BID, THE CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS AND INFORM THE ARCHITECT AND THE ENGINEER OF ANY DISCREPANCY BETWEEN THESE DOCUMENTS AND THE EXISTING CONDITIONS. THE ENGINEER IS NOT RESPONSIBLE FOR ANY ADDITIONAL COSTS RESULTING FROM VERIFIABLE EXISTING CONDITIONS DISCOVERED AFTER CONTRACT HAS BEEN AWARDED.

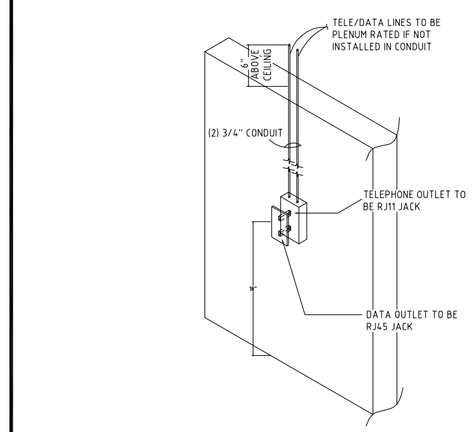

DETAIL NO. 1	DATA/TELEPHONE OUTLET	NOT TO SCALE

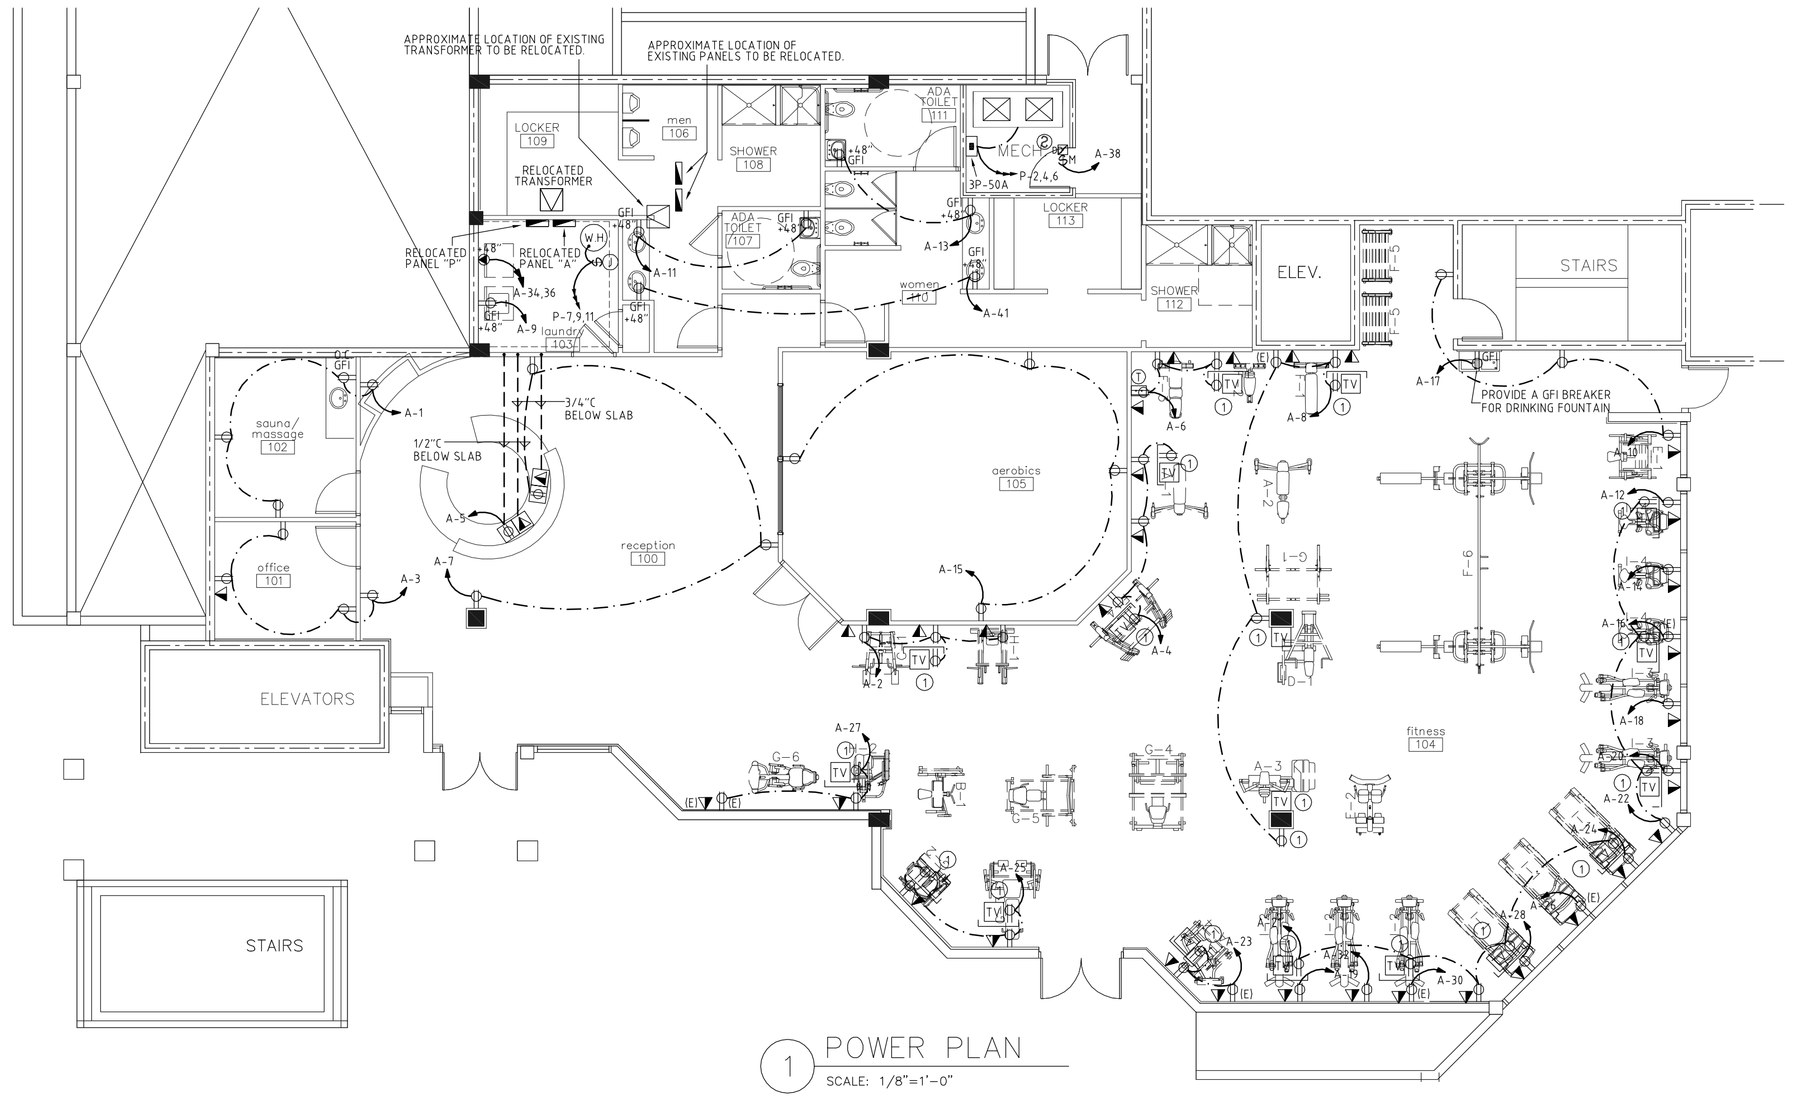

1 POWER PLAN
SCALE: 1/8"=1'-0"

ELECTRICAL SYMBOL LEGEND

	110V DUPLEX RECEPTACLE
	QUAD-PLEX RECEPTACLE
GFI	GROUND FAULT CIRCUIT INTERRUPTER
	FLOOR MOUNTED DUPLEX RECEPTACLE WITH BRASS COVER PLATE; FLUSH W/ FLOOR
	220V RECEPTACLE
J	JUNCTION BOX
	TELE/FAX/DATA PORT **
	FLOOR MOUNTED TELE/FAX/DATA PORT ** WITH BRASS COVER PLATE; FLUSH W/ FLOOR
	TELEPHONE JACK
TV	TELEVISION JACK
	TELEPHONE BOARD
	SWITCH
M	MOTOR RATED SWITCH
	FUSE DISCONNECT
	ELECTRICAL CIRCUIT BREAKER
	ELECTRICAL PANEL
	TIME SWITCH
	FACTORY INSTALLED DISCONNECT
EF	EXHAUST FAN
T	THERMOSTAT
(RE)	RELOCATE EXISTING
O.C.	OVER COUNTER

* NOTE: ALL SYMBOLS MAY NOT BE USED FOR THIS PROJECT
** PROVIDE 3/4"C WITH PULL WIRE. STUB ABOVE CEILING.

KEY NOTES

1. VERIFY MOUNTING HEIGHT OF RECEPTACLE AND TV WITH OWNER/ARCHITECT PRIOR TO CONSTRUCTION.

PRIOR TO SUBMITTING HIS BID, THE CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS AND INFORM THE ARCHITECT AND THE ENGINEER OF ANY DISCREPANCY BETWEEN THESE DOCUMENTS AND THE EXISTING CONDITIONS AND HE SHALL INCLUDE IN HIS BID TO CORRECT THE SAME AS DIRECTED. THE ENGINEER AND THE ARCHITECT, ARE NOT RESPONSIBLE FOR ANY ADDITIONAL COSTS RESULTING FROM VERIFIABLE EXISTING CONDITIONS DISCOVERED AFTER CONTRACT HAS BEEN AWARDED. NO CHANGES SHALL BE MADE TO THESE PLANS WITHOUT PRIOR APPROVAL FROM THE ENGINEER OF RECORD. ALL CHANGES SHALL BE SUBMITTED FOR REVIEW PRIOR TO INSTALLATION. NOT FOR BID UNTIL PERMIT HAS BEEN ISSUED.

PERMIT SET: 02/14/12

FAE CONSULTING
1640 N.W. Boca Raton Blvd.
Boca Raton, FL 33432
TEL: (561) 391-9292 FAX: (561) 391-9898
Certificate of authorization no. 28107
Harold R. Tussler, P.E. License #19315
Ursula Iafrate, P.E. License #73122
Martin Whitelocke, P.E. License #53899
E-mail: info@faeconsulting.com

POWER PLAN

SCALE: 1/8" = 1'-0"

0 X' X' X' X'

N W E S

GLIDDEN • SPINA & PARTNERS
ARCHITECTURE • INTERIOR DESIGN, INC.
PHONE: 561.684.6844 • FAX: 561.684.5594 • E-MAIL: info@gsp-architects.com
1401 FORUM WAY, SUITE 100 • WEST PALM BEACH, FLORIDA 33401
FL License: #AA26001602
Keith M. Spina #AR13419 Benjamin John Glidden, III #AR6536

TENANT IMPROVEMENTS FOR:
NORTHBIDGE CENTER GYM FACILITY

515 N. FLAGLER DR., SUITE P-100
WPB, FLORIDA

COPYRIGHT 2009
THESE DRAWINGS ARE FOR THE EXCLUSIVE USE OF GLIDDEN SPINA & PARTNERS, INC. AND MAY NOT BE DUPLICATED, REPRODUCED OR USED IN ANY MANNER WITHOUT THE EXPRESS WRITTEN CONSENT OF GLIDDEN SPINA & PARTNERS, INC. ALL RIGHTS RESERVED.

sheet title: POWER PLAN
file name: 11436_E1.1(2).DWG

revisions:

project no: 11436
date: 02/14/12
drawn by: ANV/CI/AS
checked by: UI

E1.1